


- NOTES:**
1. All wall- floor joists & crawlspace sealed w/ plastic membrane.
  2. Possible pipe routing thru closet or pipe chase.

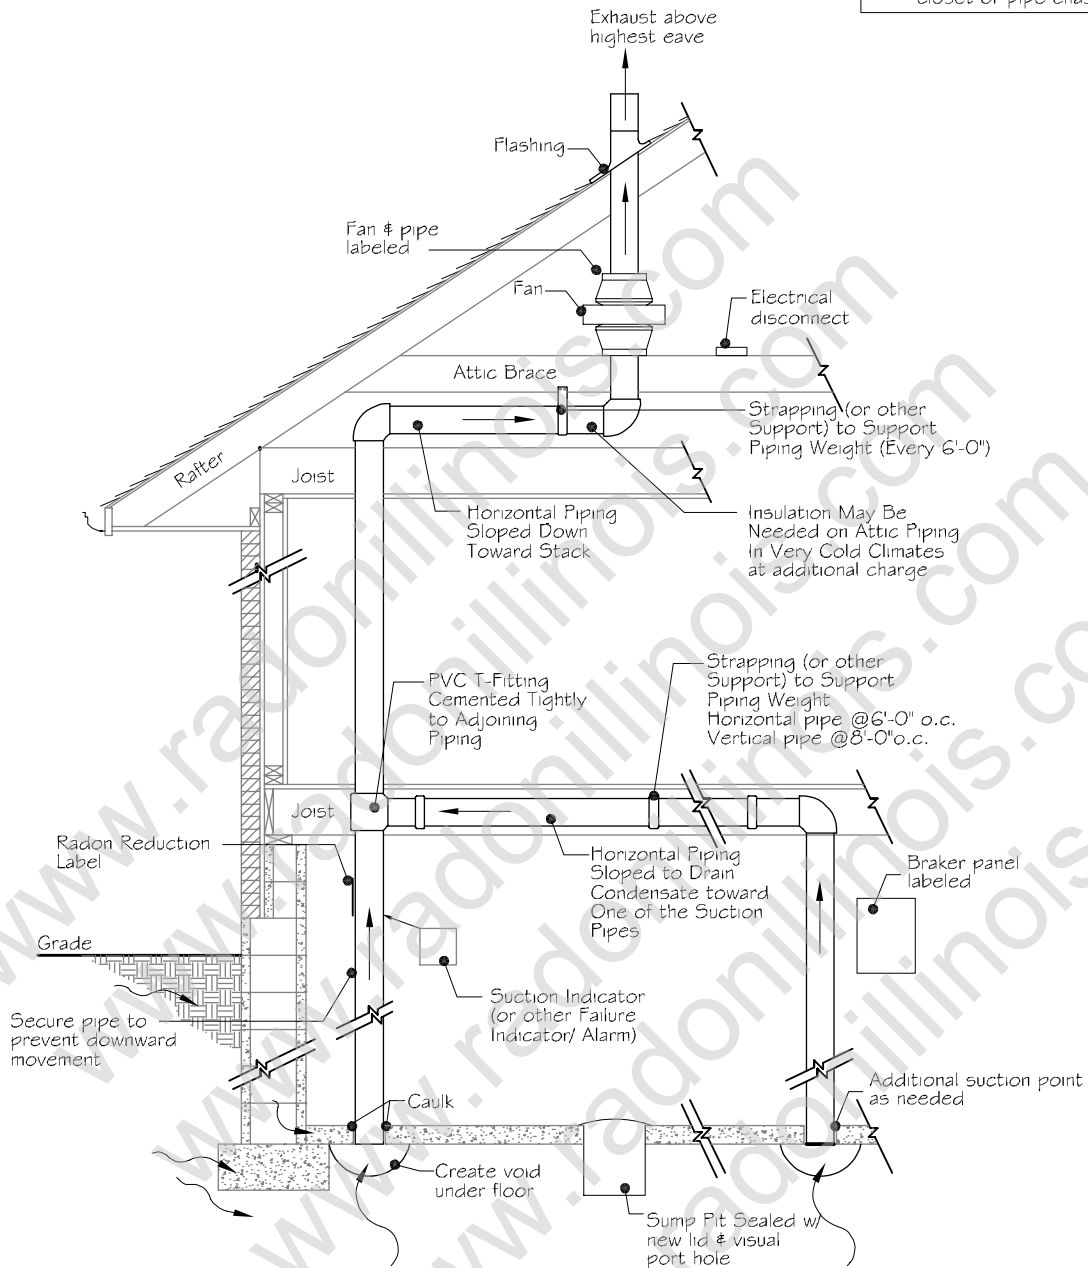

RADON MITIGATION SYSTEM CONFIGURATION  
 illustrating an interior exhaust stack